


#	DESCRIPTION	NOTES
1	FIREHALT 120:60:MJS	Nominal Width - 400mm
2	120:60:MJS OVERLAPS	Nominal - 100mm
3	50 X 25 x 0.7mm GALV ANGLE	Joints: 150mm Overlaps
4	SUITABLE FIRE RESISTANT FIXINGS	250mm Fixing Centres
5	FIXINGS FROM GAP EDGE	Suggested Minimum - 70mm
6	CEILING/FLOOR SLAB	



Tel : +44 (0)161 344
 Fax : 2484
 Email : +44 (0)161 344
 Web : 2486

Fixing detail may not be suitable for all applications. If in doubt seek assistance from our technical staff or another qualified person before installation

Title: Standard Fixing Detail	Products: Firehalt 120:60:MJS Barrier	Fix Detail : #11a
Project:		Version: 1
Assessment Ref: WF 385087_3		Date: 01/08/2017

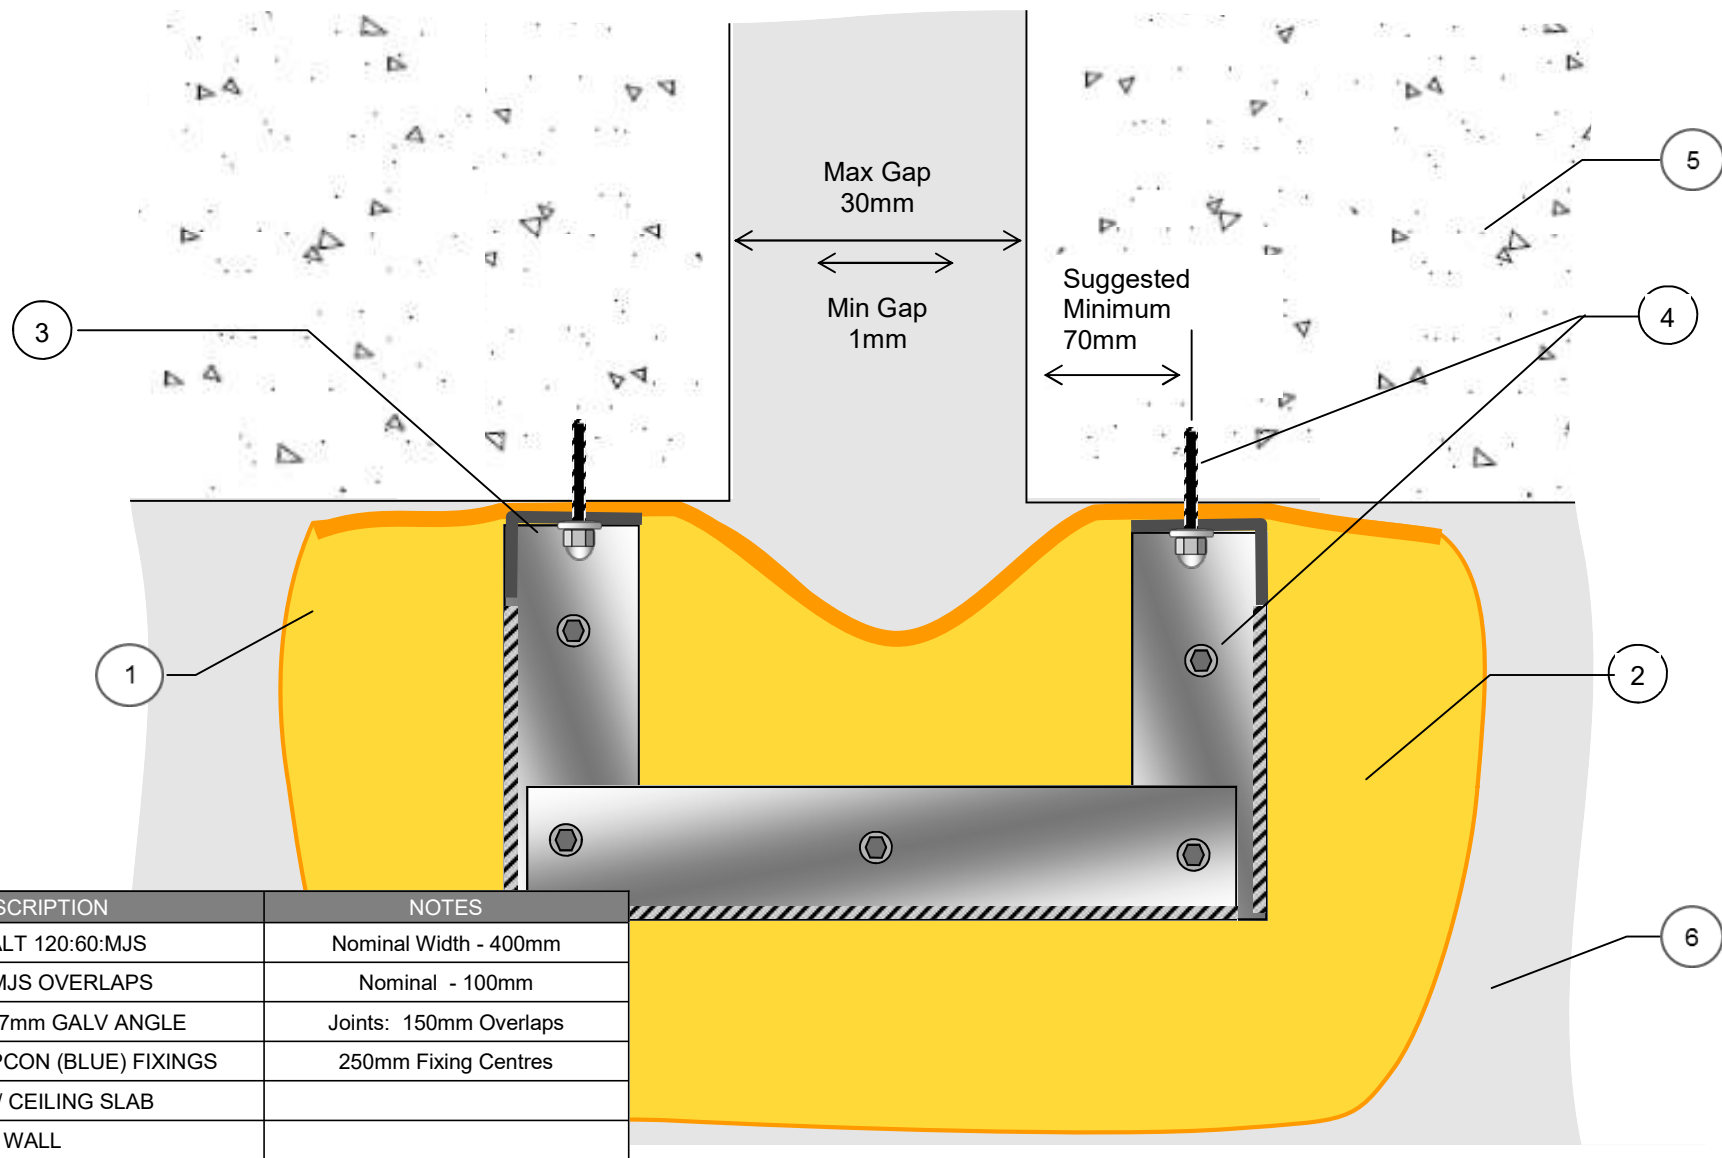


#	DESCRIPTION	NOTES
1	FIREHALT 120:60:MJS	Nominal Width - 400mm
2	120:60:MJS OVERLAPS	Nominal - 100mm
3	50 X 25 x 0.7mm GALV ANGLE	Joints: 150mm Overlaps
4	40 - 50mm TAPCON (BLUE) FIXINGS	250mm Fixing Centres
5	FLOOR / CEILING SLAB	
6	WALL	



Tel : +44 (0)161 344
 Fax : 2484
 Email : +44 (0)161 344
 Web : 2486

Fixing detail may not be suitable for all applications. If in doubt seek assistance from our technical staff or another qualified person before installation

Title: Movement Joint Seal - slab to wall	Products: Firehalt 120:60:MJS Barrier	Fix Detail : # 11b
Project:		Version: 1
Assessment Ref: WF 385087_3		Date: 20/06/2017

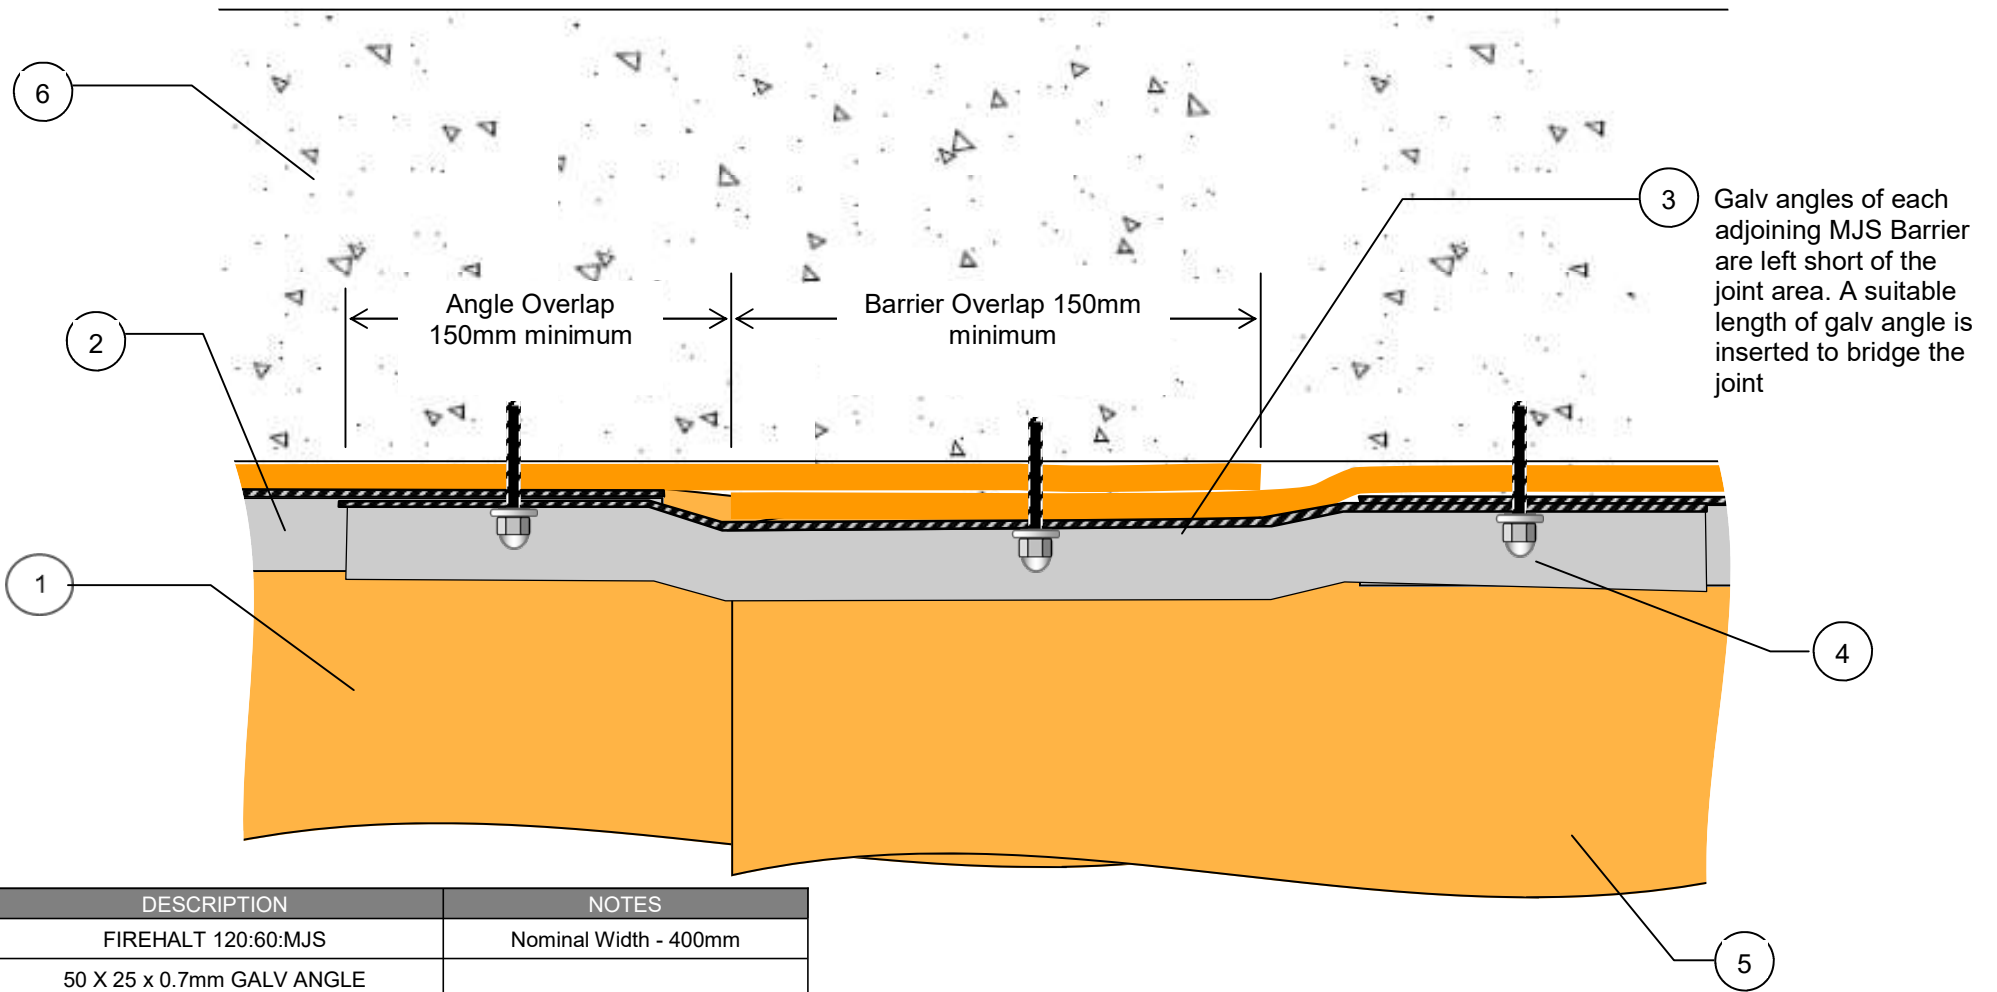


#	DESCRIPTION	NOTES
1	FIREHALT 120:60:MJS	Nominal Width - 400mm
2	50 X 25 x 0.7mm GALV ANGLE	
3	50 X 25 x 0.7mm BRIDGING ANGLE	Joints: 150mm Overlaps
4	SUITABLE FIRE RESISTANT FIXINGS	250mm Fixing Centres
5	120:60:MJS OVERLAPS	Nominal - 100mm
6	CEILING/FLOOR SLAB	



Tel : +44 (0)161 344
 Fax : 2484
 Email : +44 (0)161 344
 Web : 2486

Fixing detail may not be suitable for all applications. If in doubt seek assistance from our technical staff or another qualified person before installation

Title: M J S: Overlapping Joining Seam	Products:	Fix Detail : # 11c
Project:	Firehalt 120:60:MJS Barrier	Version: 1
Assessment Ref: WF 385087_3		Date: 20/06/2017

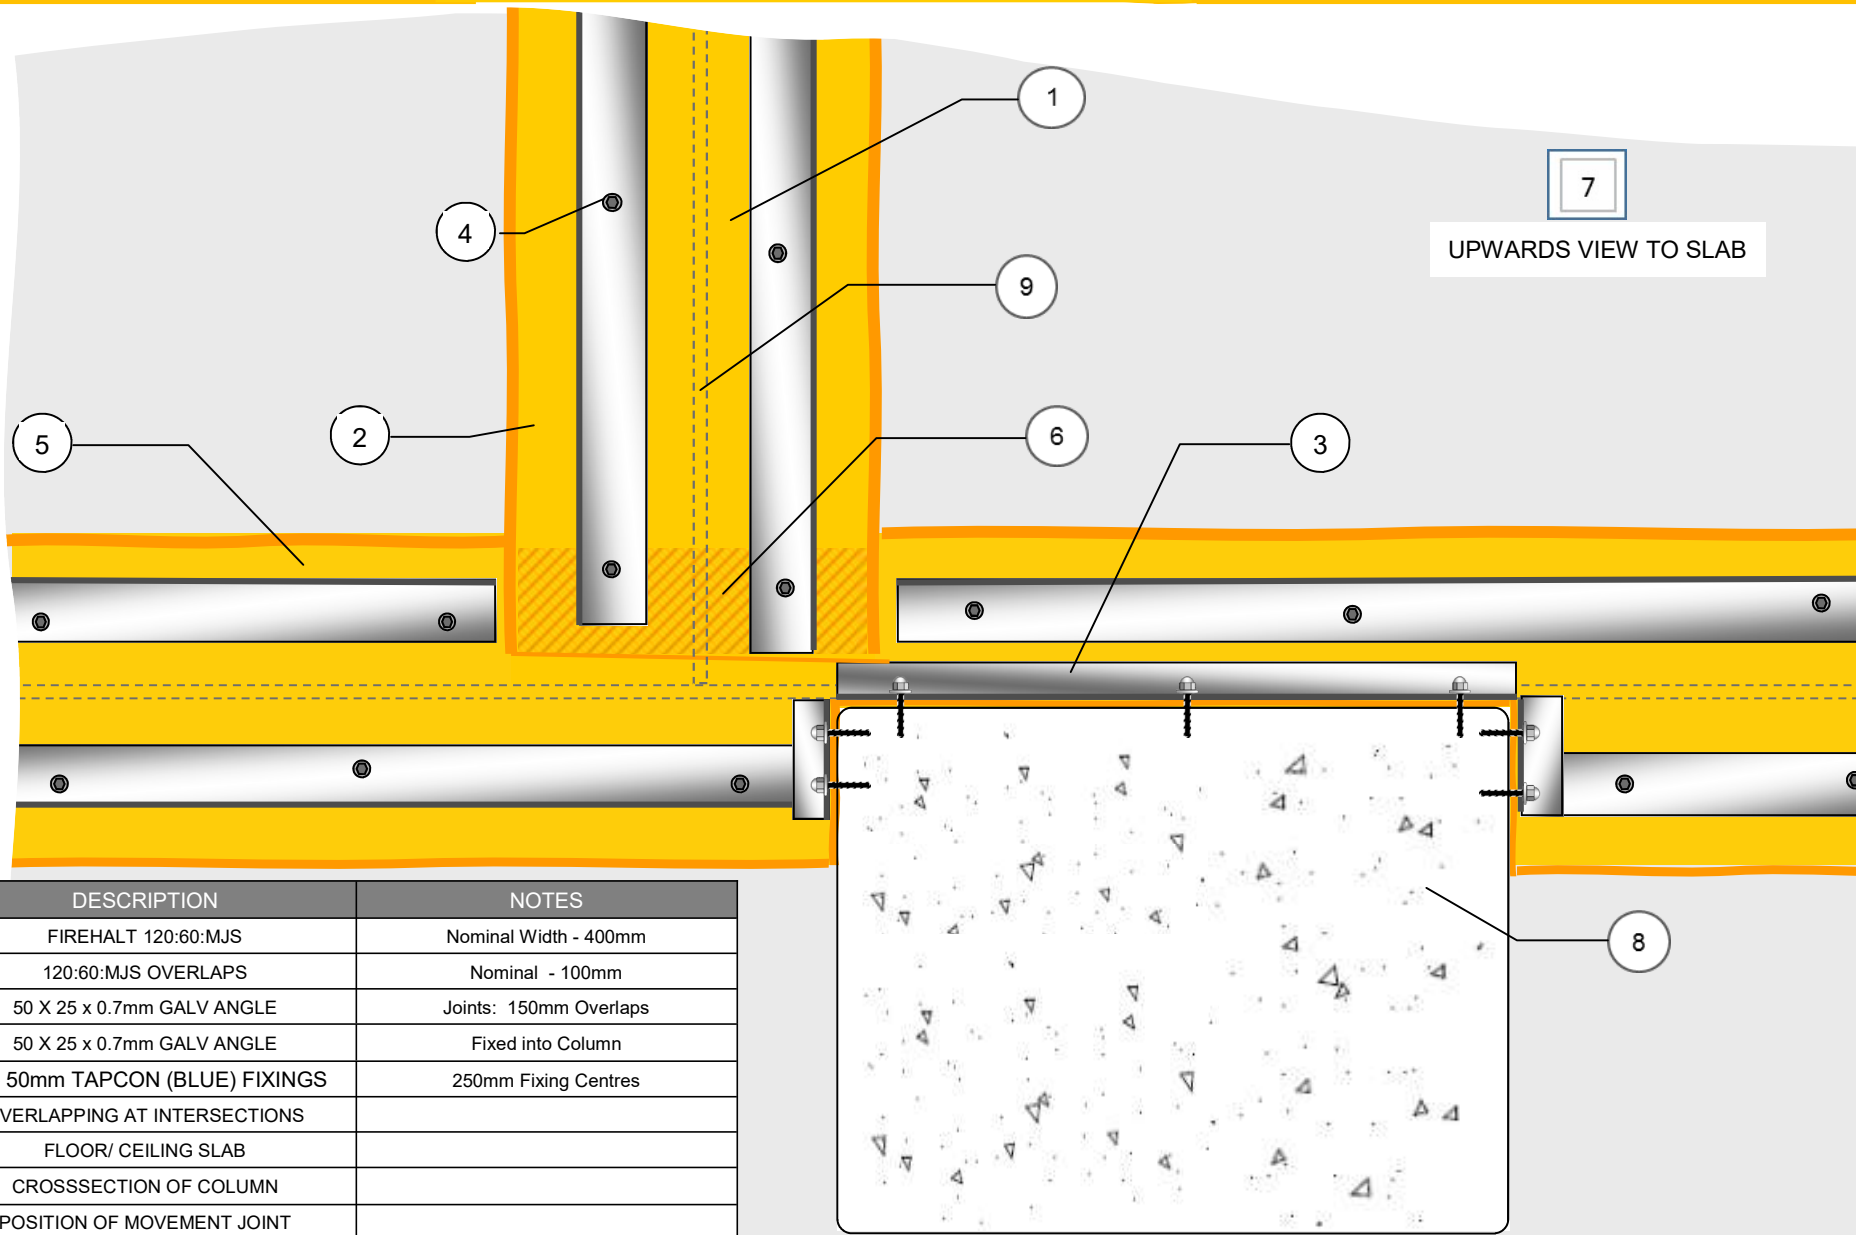


#	DESCRIPTION	NOTES
1	FIREHALT 120:60:MJS	Nominal Width - 400mm
2	120:60:MJS OVERLAPS	Nominal - 100mm
3	50 X 25 x 0.7mm GALV ANGLE	Joints: 150mm Overlaps
4	50 X 25 x 0.7mm GALV ANGLE	Fixed into Column
5	40 - 50mm TAPCON (BLUE) FIXINGS	250mm Fixing Centres
6	OVERLAPPING AT INTERSECTIONS	
7	FLOOR/ CEILING SLAB	
8	CROSSECTION OF COLUMN	
9	POSITION OF MOVEMENT JOINT	



Tel : +44 (0)161 344
 Fax : 2484
 Email : +44 (0)161 344
 Web : 2486

Fixing detail may not be suitable for all applications. If in doubt seek assistance from our technical staff or another qualified person before installation

Title: Movement Joint Seal - Intersections & Columns	Products: Firehalt 120:60:MJS Barrier	Fix Detail : # 11d
Project:		Version: 1
Assessment Ref: WF 385087_3		Date: 20/06/20

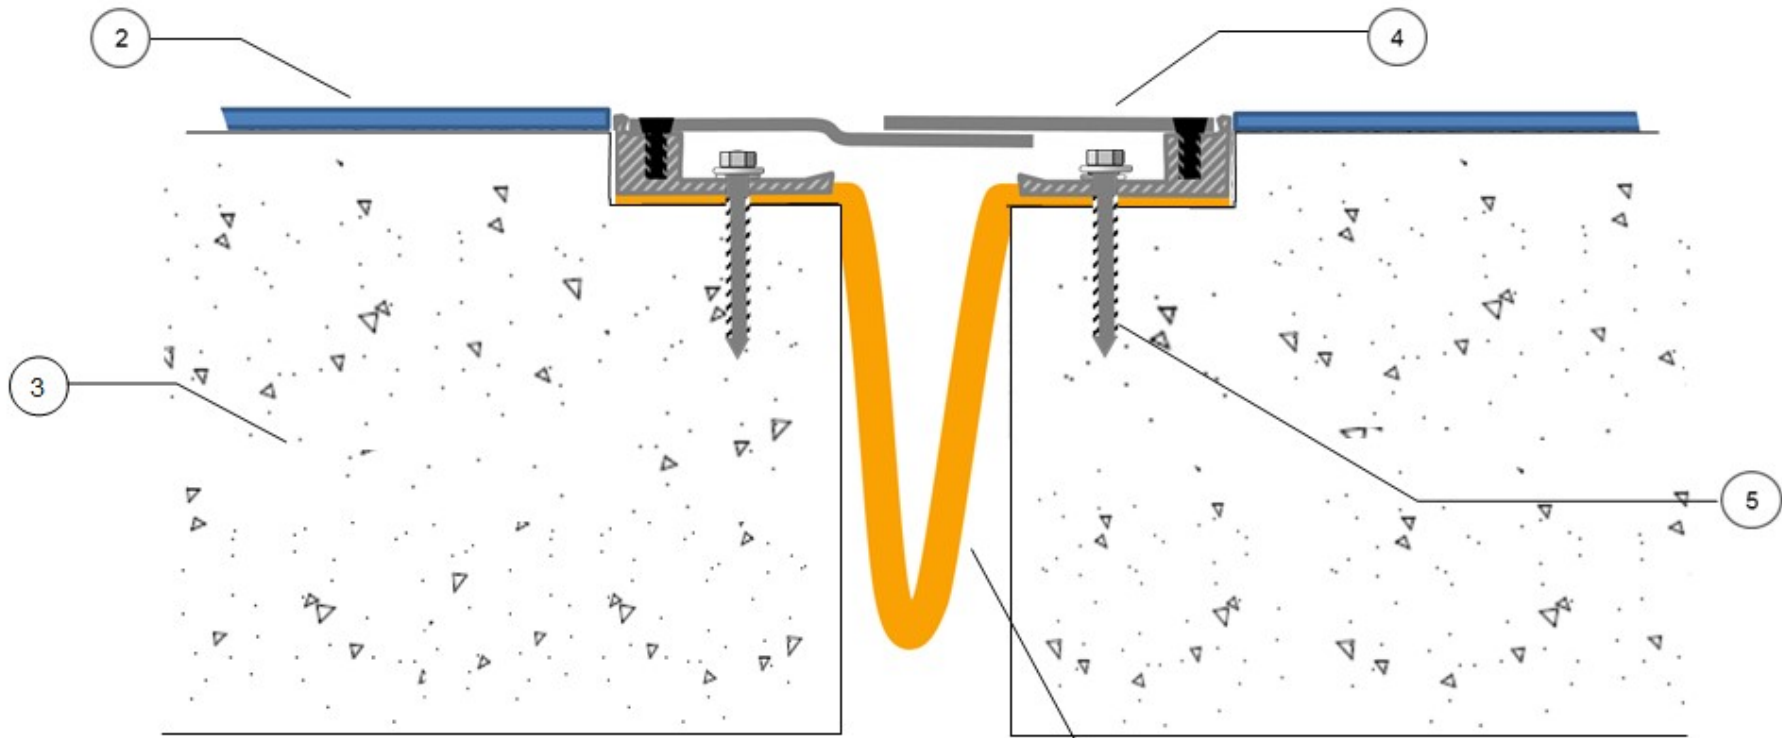

#	DESCRIPTION	NOTES
1	FIREHALT BARRIER	Barrier Width = Min/Max Gap Dims
2	VINYL FLOOR COVERING	
3	FLOOR SLAB	
4	PROPRIETRY METAL COVER PLATE SYSTEM	
5	SUITABLE ANCHOR FIXINGS	250mm Centres
6		

Min / Max
Gap Dims

1 Relaxed thickness - 8mm
Compressed thickness - 5mm



Tel : +44 (0)161 344
 Fax : 2484
 Email : +44 (0)161 344
 Web : 2486

Fixing detail may not be suitable for all applications. If in doubt seek assistance from our technical staff or another qualified person before installation

Title: 30min Fire Rated Flexible Joint Seal.	Products:	Fix Detail : # 11e
Project:	Firehalt 120:30	Version: 1
Assessment Ref: WF 176621_2		Date: 27/04/2016